

NOTES

1. DO NOT SCALE OFF FROM THIS DRAWING. ALL CONTRACTORS MUST CHECK ON SITE. ALL DIMENSIONS AND INFORMATION PROVIDED ANY QUERIES OR DISCREPANCIES MUST BE REFERRED TO THE PROJECT ARCHITECT BEFORE MATERIALS ARE ORDERED OR WORK PUT IN HAND.
2. THE CONTRACTOR IS RESPONSIBLE FOR THE STRUCTURAL STABILITY AND EFFICIENT PERFORMANCE OF FESHER WORK.
3. THESE ARE THE ILLUSTRATION DRAWINGS FOR THE STANDARDS.
4. THESE DRAWINGS ARE FOR GUIDELINES ILLUSTRATION PURPOSES ONLY.



No.	DESCRIPTION	BY	DATE
-----	-------------	----	------

REVISIONS



THE CHIEF EXECUTIVE OFFICER
MALAWI ENERGY REGULATION AUTHORITY (MERA)
PRIVATE BAG B-496
CAPITAL CITY
LILONGWE 3

MERA CONSTRUCTION GUIDELINES


CLIENT
MALAWI ENERGY REGULATION AUTHORITY (MERA)

DRAWING NAME
LPG WITH MORE THAN ONE TANK FARM SERVICES LAYOUT PLAN

DRAWN	DATE	SCALE
L. KAPENDA	MARCH 2020	1:500 ON A3 PAPER
CHECKED	ACT. CRSE.	D.O.B.
ENG. A. CHIKUSE	ENG. A. CHIKUSE	M. J. K. CHIKUSE

DRAWING NUMBER
FILE No SERIAL No REVISION No

4.006

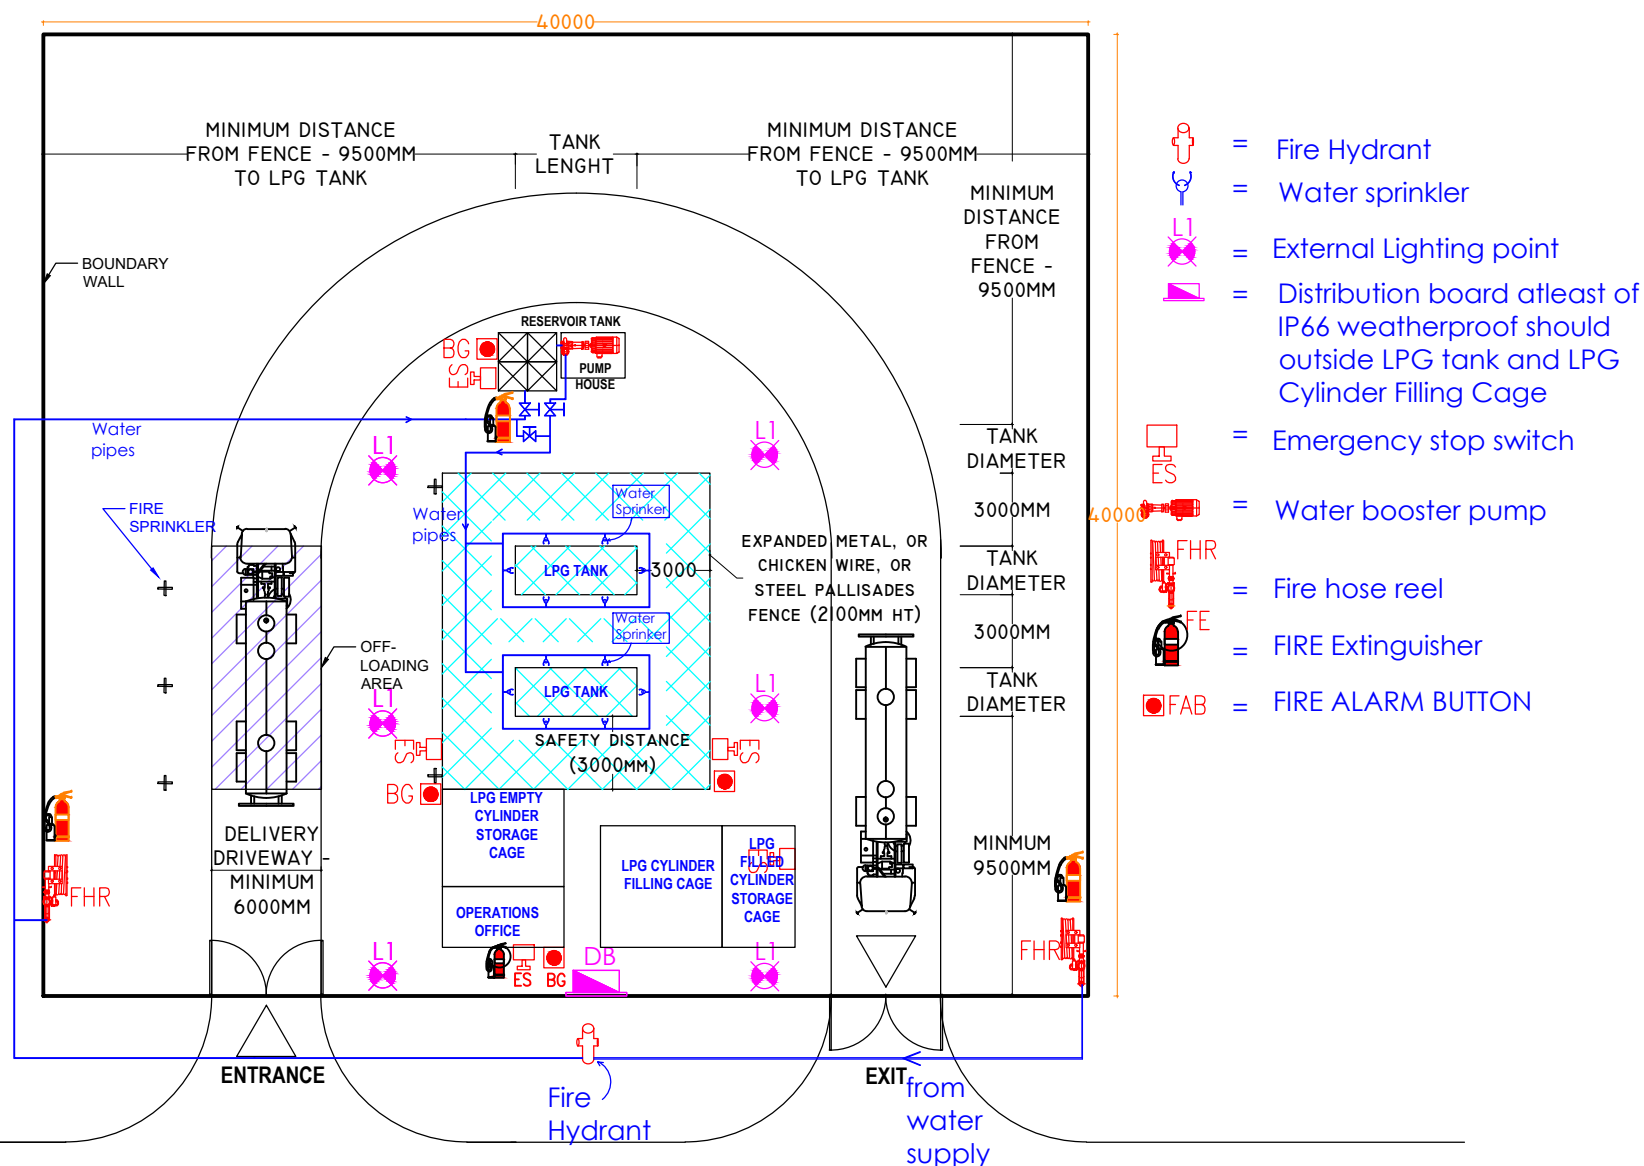

- = Fire Hydrant
- = Water sprinkler
- = External Lighting point
- = Distribution board atleast of IP66 weatherproof should be outside LPG tank and LPG Cylinder Filling Cage
- = Emergency stop switch
- = Water booster pump
- = Fire hose reel
- = FIRE Extinguisher
- = FIRE ALARM BUTTON